


ARIES WALL HEATER - Installation Diagram for Separate Control (NS)



Minimum Safety Distances

	A	B
ARI3-45NS-WL	100	1900
ARI3-60NS-WL	100	1900
ARI3-75NS-WL	100	1900
ARI3-90NS-WL	100	1900

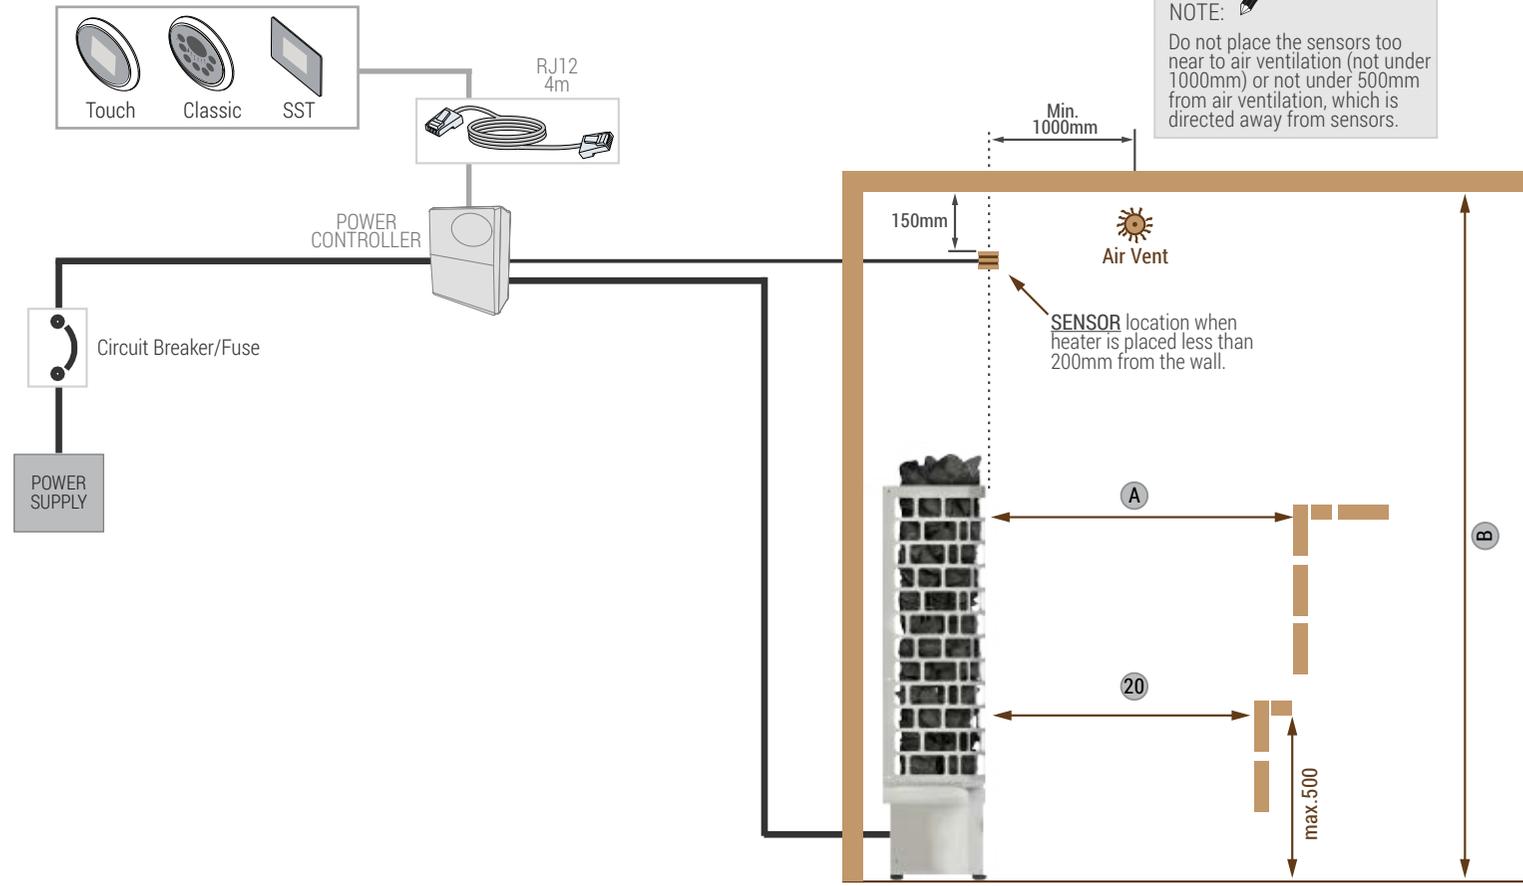

ARIES WALL HEATER- Installation Diagram for Built Control (NB)

Minimum Safety Distances

	A	B
ARI3-45NB-WL	100	1900
ARI3-60NB-WL	100	1900
ARI3-75NB-WL	100	1900
ARI3-90NB-WL	100	1900

